

DATE SUBMITTED 11/08/2022
 SUBMITTED BY Public Services
 DATE ACTION REQUIRED 11/16/2022

COUNCIL ACTION ()
 PUBLIC HEARING REQUIRED ()
 RESOLUTION ()
 ORDINANCE 1ST READING ()
 ORDINANCE 2ND READING ()
 CITY CLERK'S INITIALS ()

**IMPERIAL CITY COUNCIL
 AGENDA ITEM**

SUBJECT: Continue Emergency Lift Stations	DISCUSSION/ACTION: Declare Emergency at Hwy 86 & Aten Rd. I. Continue Emergency Action of Resolution NO. 2022-60
DEPARTMENT INVOLVED: <u> Public Services – Waste Water </u>	
BACKGROUND/SUMMARY: After replacing suction lines at three lift stations back in mid- June, Public Services inspected other pump & lift stations and found four other stations needing suction lines removed and replaced. Bracing and supports for these suction lines have also failed and will be replaced, as well. This is critical and considered an emergency repair to continuing to provide sewer collection in the areas of: Sandalwood Glen, Sky Ranch, Cross & Colonia Pump/Lift Stations. If lines continue to fail, these lift stations will not be able to function; each one currently has a failed line and are running at 50%. Public Services is continuing to work with A&R Construction to rectify issues.	
FISCAL IMPACT: TBD	FINANCE INITIALS <u> <i>DE</i> </u>
STAFF RECOMMENDATION: Council continues approval of emergency action	DEPT. INITIALS <u> <i>[Signature]</i> </u>
MANAGER'S RECOMMENDATION: <u> <i>approve continue</i> </u>	CITY MANAGER'S INITIALS <u> <i>DM</i> </u>
MOTION: SECONDED: _____ AYES: _____ NAYES: _____ ABSENT: _____	
APPROVED () REJECTED () DISAPPROVED () DEFERRED () REFERRED TO: _____	



Agenda Item No. E-5

DATE SUBMITTED: 09/14/2022
 SUBMITTED BY: Public Services
 DATE ACTION REQUIRED: 09/21/2022

COUNCIL ACTION ()
 PUBLIC HEARING REQUIRED ()
 RESOLUTION ()
 ORDINANCE 1ST READING ()
 ORDINANCE 2ND READING ()
 CITY CLERK'S INITIALS AB

**IMPERIAL CITY COUNCIL
 AGENDA ITEM**

SUBJECT: Emergency Replacement of Pump Station Suction Lines DISCUSSION/ACTION: 1. Discuss and approve Emergency Replacement of Suction Lines at various Pump & Lift Stations	
DEPARTMENT INVOLVED: Public Services – Waste Water Collections	
BACKGROUND/SUMMARY: After replacing suction lines at three lift stations back in mid- June, Public Services inspected other pump & lift stations and found four other stations needing suction lines removed and replaced. Bracing and supports for these suction lines have also failed and will be replaced, as well. This is critical and considered an emergency repair to continuing to provide sewer collection in the areas of: Sandalwood Glen, Sky Ranch, Cross & Colonia Pump/Lift Stations. If lines continue to fail, these lift stations will not be able to function; each one currently has a failed line and are running at 50%.	
FISCAL IMPACT: TBD	FINANCE INITIALS <u>DP</u>
STAFF RECOMMENDATION: Approve	DEPT. INITIALS <u>JCP</u>
MANAGER'S RECOMMENDATION: <i>approve staff recommendation to repair on emergency basis</i>	CITY MANAGER'S INITIALS <u>AJH</u>
MOTION:	
SECONDED: AYES: NAYES: ABSENT:	APPROVED () DISAPPROVED () REJECTED () DEFERRED () REFERRED TO:

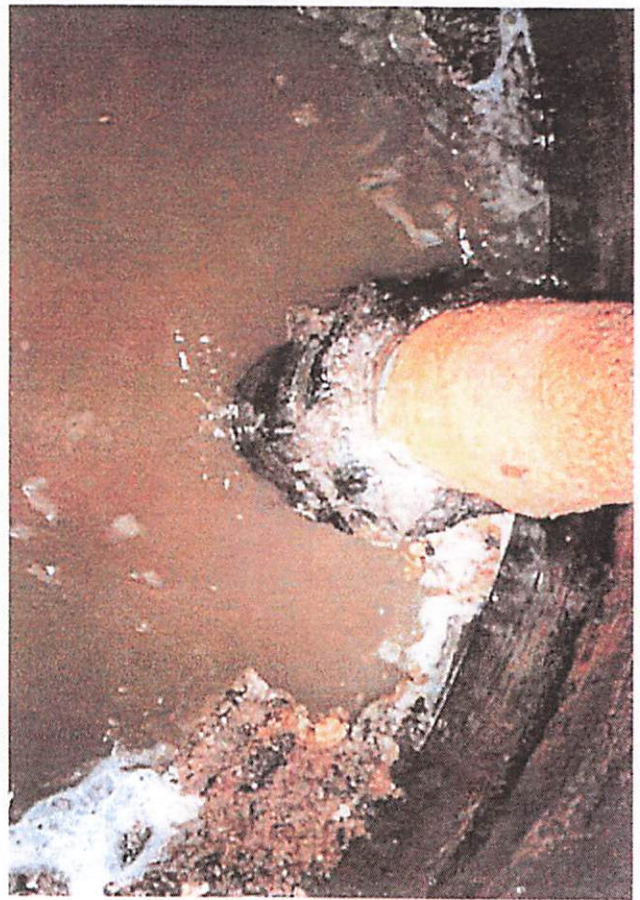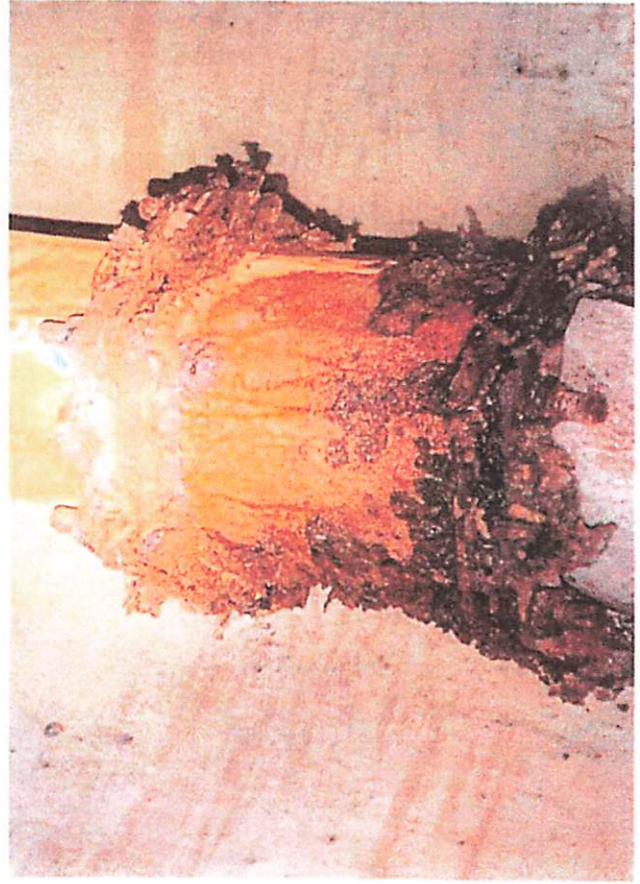

RESOLUTION NO. 2022-60

**RESOLUTION DECLARING AN EMERGENCY,
RATIFYNG ACTION TAKEN TO ADDRESS THE
EMERGENCY AND AUTHORIZING PAYMENT**

**WHEREAS, the City operates and maintains a wastewater collection system ("System");
and**

**WHEREAS, the System includes lift stations at various locations including Sandalwood
Glen and Aten, Colonia pump station, Cross and Aten and Sky Ranch pump station; and**

**WHEREAS, it has been discovered that a pipe in the above referenced pump stations is in
a deteriorated condition; and**

**WHEREAS, if the pipe were to fail, a sewer spill could occur and such sewer spill could
pose a threat to the public health and safety; and**

**WHEREAS, the above described condition constitutes an emergency under applicable
law and such emergency would not reasonably permit delays associated with a competitive
solicitation for bids and the actions taken herein were necessary to respond to the emergency;
and**

**WHEREAS, in order to safeguard the public health and safety, it was necessary to take
immediate action to repair/replace the pipe in the above described lift stations; and**

**WHEREAS, the City Council wishes to ratify action taken by staff and the City Manager
to cause the above described lift stations to be repaired.**

NOW, THEREFORE, BE IT RESOLVED AS FOLLOWS:

**1. The above-referenced recitals are true and correct and are incorporated
herein.**

**2. The City Council declares that the public interest and necessity demands
the immediate expenditure of public money to safeguard life, health or property, and hereby
ratifies action taken by staff and the City Manager to repair/replace the pipe in the above
described lift stations on an emergency basis to safeguard life, health or property in accordance
with Public Contracts Code Sections 20168 and 22050 and without otherwise complying with
bid requirements required by law.**

**3. The City Council authorizes payment for repair/replacement of the pipe in
the above described lift stations. The City Council authorizes payment for all of such expenses
on an emergency basis.**

**APPROVED, PASSED AND ADOPTED, at the regular meeting of the City Council
this 21st day of September, 2022.**

Geoff Dale, Mayor

ATTEST:

City Clerk